


A T-K2 or T-K1S System for Hydronic Heating and Domestic

QTY	Basic Application Specs.
1	T-K2 or T-K1S
1	TK-TV03
1	TK-RE01 Optional
1	Recir. Pump Required

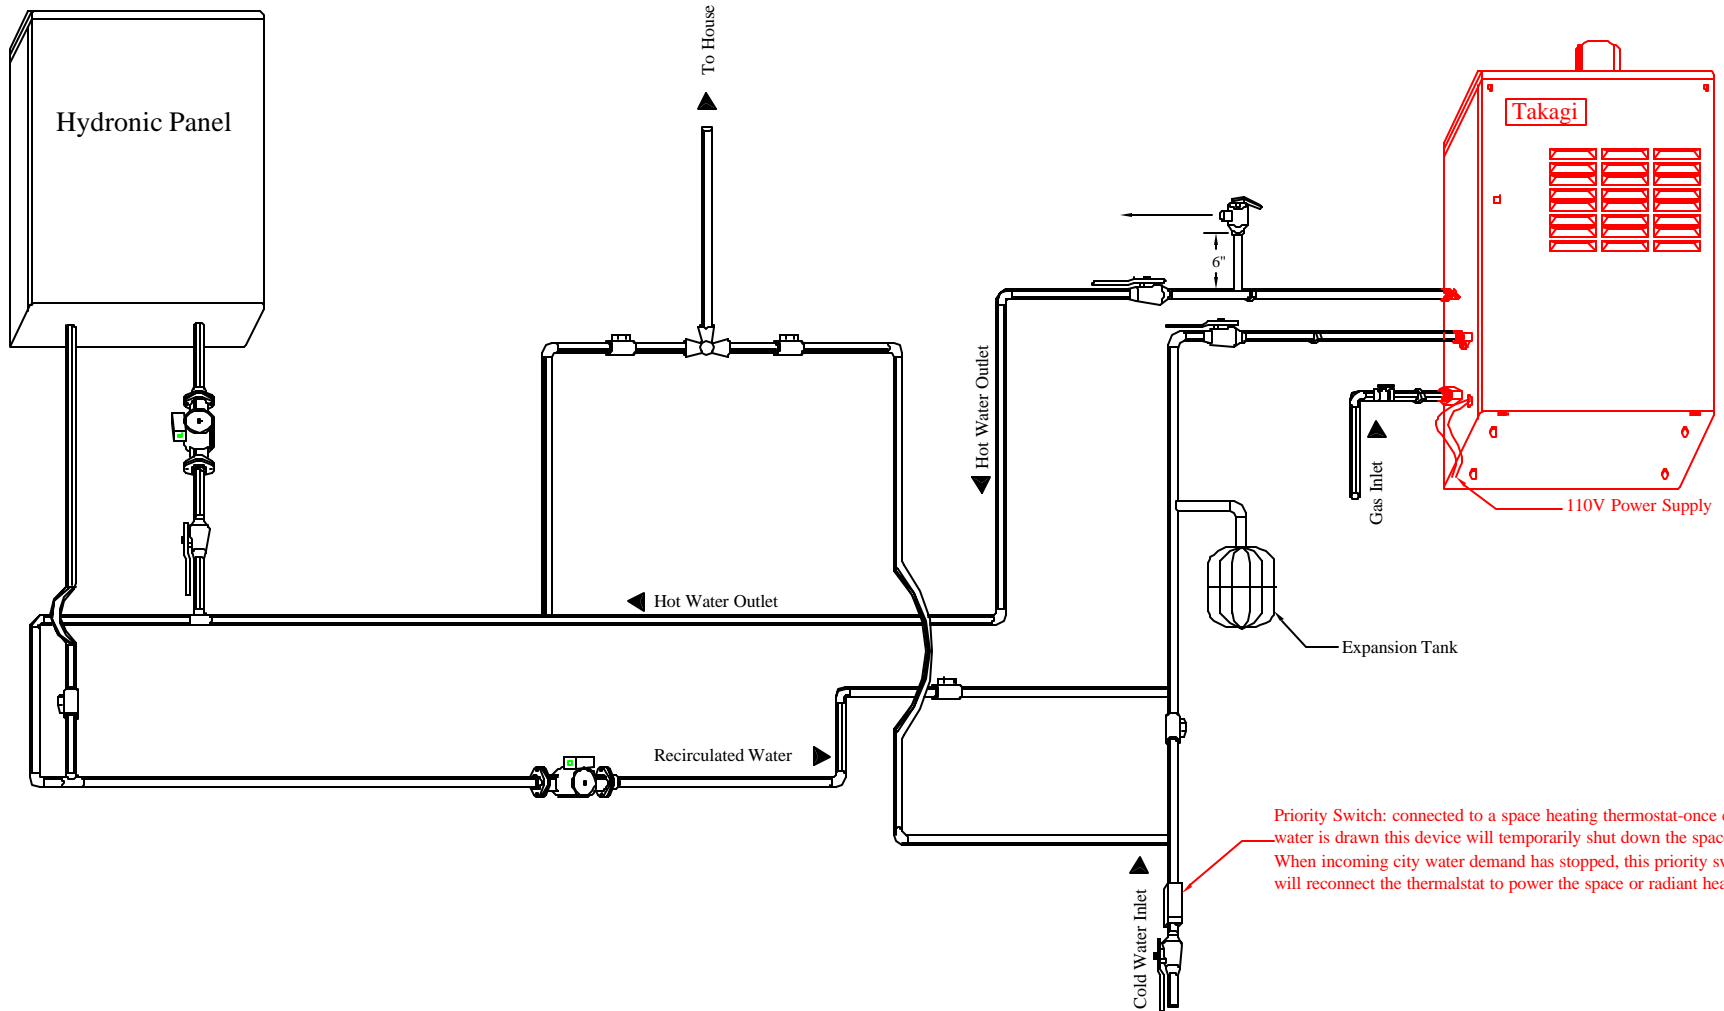

Priority Switch: connected to a space heating thermostat-once city water is drawn this device will temporarily shut down the space heater. When incoming city water demand has stopped, this priority switch will reconnect the thermostat to power the space or radiant heater.

Takagi USA

3-B Goodyear
 Irvine, CA 92618
 Phone: (888) 882-5244
 Fax: (949) 770-3171
 www.Takagi-USA.com

Note: This drawing is intended as a basic guide. Local and State Codes dictate correct installation. Each individual application, gas pipe diameter, pump size, and expansion tank must be sized correctly.

	Min. Ø 3/4" Gas Shut-off Ball Valve		Pressure Only Relief Valve		Recirculation Pump Min. 1/12 Hp		Mixing Valve
	Water Shut-off Ball Valves		Unions		Check Valves		Priority Switch