



## Outdoor Installation

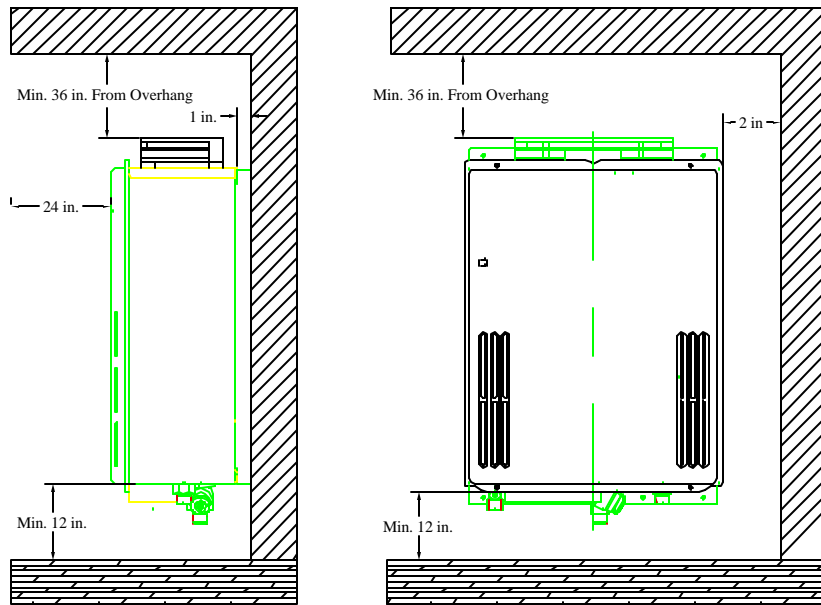

## Indoor Installation

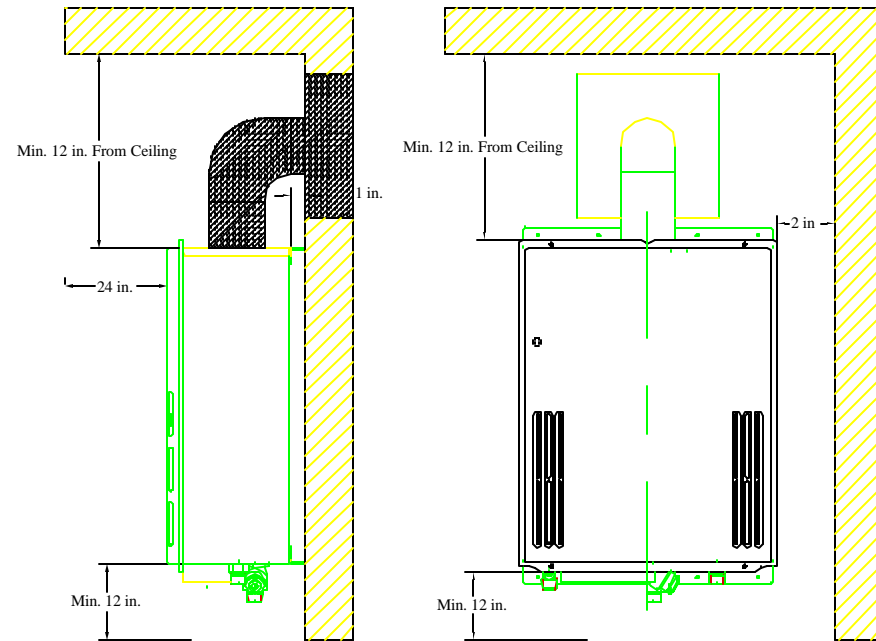

### Minimum recommended Air Supply to Water Heater

Outside Air Area	Inside Air Area
59 Sq. In.	235 Sq. In.

### Flue Vent

Diameter	Max. No. of Elbows	Max. Vertical or Horizontal run in Length
4 in.	3	35 ft.

Deduct 5 ft. from max. length for each added 90 degree elbow

Note: All dimensions are not proportional

