


# A T-M1 with Storage Tank

QTY	Basic Application Specs.
1	T-M1
1	TK-TV03
1	TM-RE10 Optional
1	Recir. Pump Required

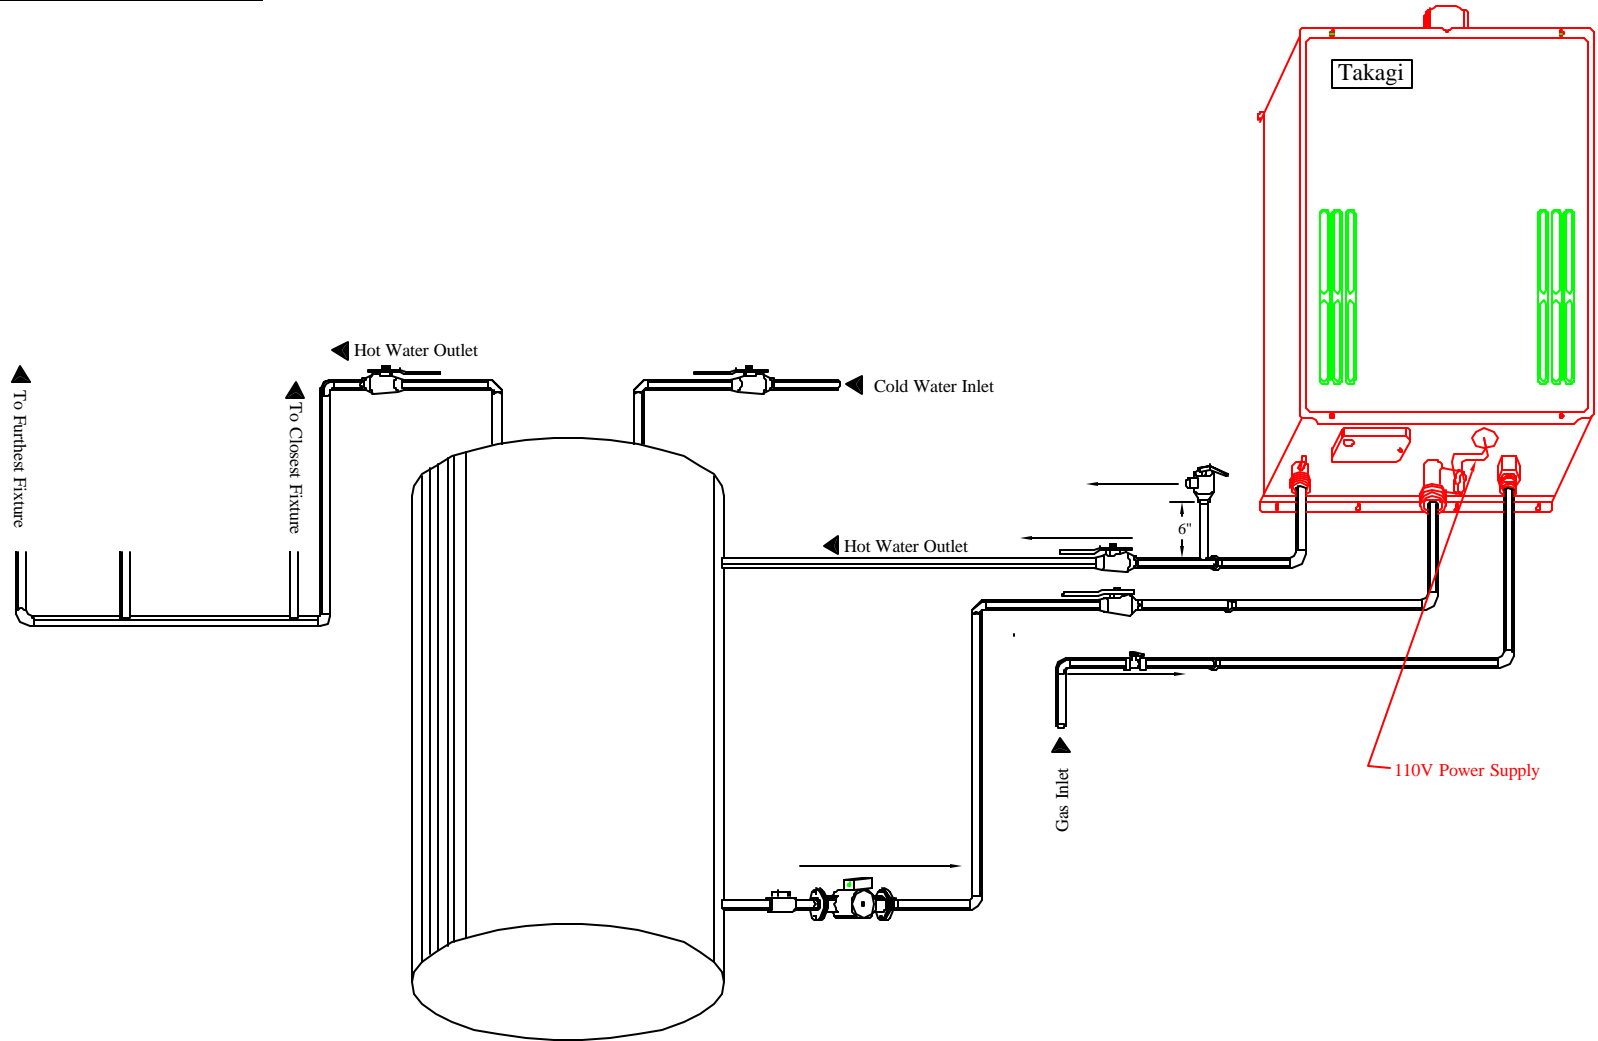

## Takagi USA

3-B Goodyear  
 Irvine, CA 92618  
 Phone: (888) 882-5244  
 Fax: (949) 770-3171  
 www.Takagi-USA.com

Note: This drawing is intended as a basic guide. Local and State Codes dictate correct installation. Each individual application, pump size, and gas pipe diameter must be sized correctly.



Recirculation Pump  
 Min. 1/12 Hp



Pressure Only Relief Valve



Min. Ø 3/4" Gas Shut-off Ball Valve



Water Shut-off Ball Valves



Unions



Check Valves